


GRANITE BLOCK CURB DETAIL

N.T.S.

CURB NOTES

- 1) 4" THICK, COARSE AGGREGATE SIZE NO. 57 SHALL BE CONSTRUCTED UNDERNEATH PROPOSED CURB IN WET FIELD CONDITIONS AS DIRECTED BY THE ENGINEER.
- 2) TOP OF CURB SHALL NOT BE SET HIGHER THAN ADJACENT EXISTING OR PROPOSED SIDEWALK UNDER ANY CONDITION.
- 3) FULL DEPTH REPAIR TO BE CONSTRUCTED ALONG THE ROAD EDGE OF NEW CURB UP TO 4' WIDE. COST TO BE INCLUDE IN PRICE OF CURB. SEE FULL DEPTH REPAIR DETAIL

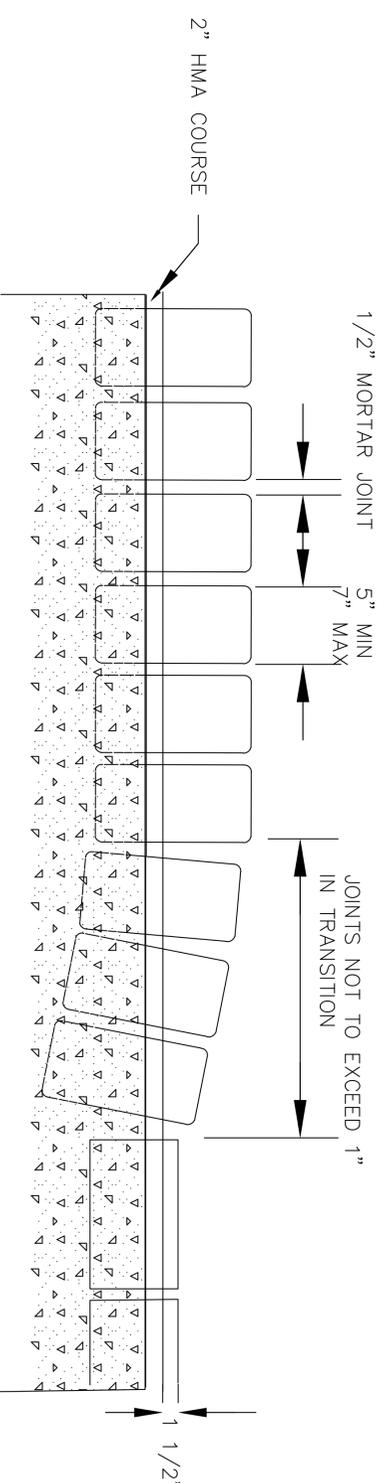

DEPRESSED GRANITE BLOCK CURB DETAIL

N.T.S.



GRANITE BLOCK CURB DETAIL

CITY OF SUMMIT, UNION CO., N.J.  
DIVISION OF ENGINEERING

DATE: 7/16/12