


NOTE: 1) ALL SIDEWALK MUST BE SPRAYED WITH WHITE PIGMENTED CURING COMPOUND AFTER BROOM FINISHING. 2) CONCRETE TO BE POURED OVER 2" LAYER OF COMPACTED CLEAN STONE. 3) CONCRETE TO BE CLASS B 3500LB MIX.

CONCRETE SIDEWALK DETAIL  
N.T.S.



CONCRETE SIDEWALK DETAIL  
N.T.S.

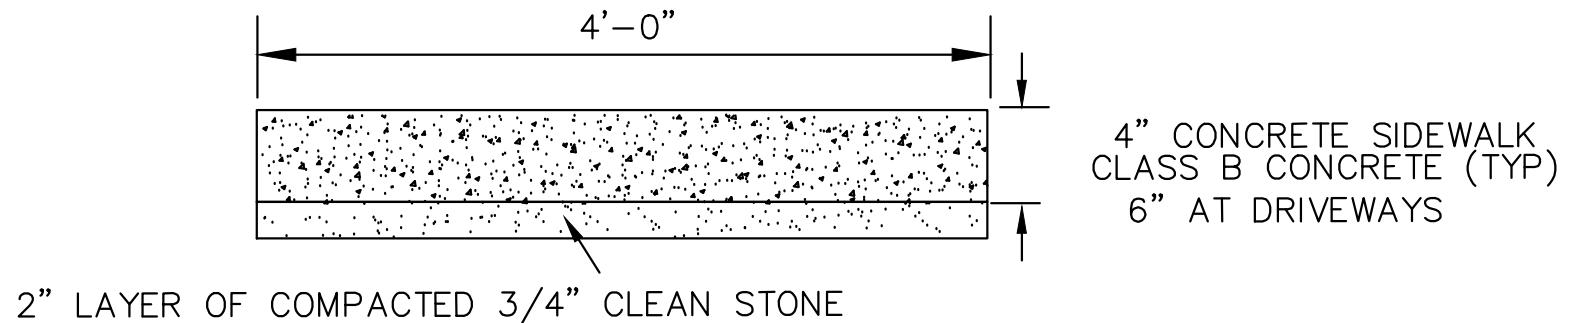

CONCRETE SIDEWALK DETAIL

CITY OF SUMMIT UNION CO., N.J.  
DIVISION OF ENGINEERING

DATE:  
10/1/2011